


## Kingsine Electric Automation Co., Ltd.

6/F, Block 4-CD, TianAn Cyber Park, Shenzhen 518048, China.

Tel: +86(755)8341 8941 Fax: +86(755)8835 2611 Email: roger@kingsine.com.cn

### **K1066+ Protective Relays Tester**

### **Power-duration Curve with Current Output**

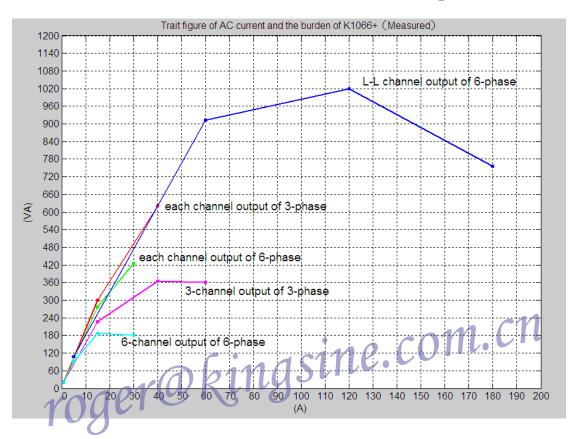

Note	Description
6-channel output of 6-phase	6-channel current output at same time and same value in 6-phase
3-channel output of 3-phase	3-channel current output at same time and same value in 3-phase
each channel output of 6-phase	Each-channel current output of 6-phase
each channel output of 3-phase	Each-channel current output of 6-phase
L-L channel output of 6-phase	All current paralleled output in 3-phase as 3-in-1 or 6-phase 6-in-1




# Kingsine Electric Automation Co., Ltd.

6/F, Block 4-CD, TianAn Cyber Park, Shenzhen 518048, China.

Tel: +86(755)8341 8941 Fax: +86(755)8835 2611 Email: roger@kingsine.com.cn

### **K1066+ Protective Relays Tester**

### **Power-duration Curve with Voltage Output**

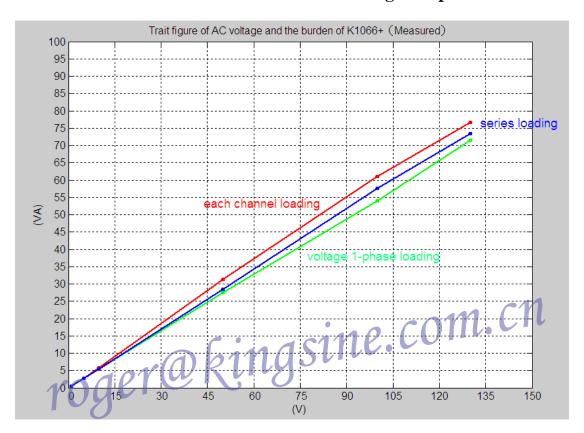

Marks	Description
Voltage 1-phase loading	1-channal Voltage output
Each channel loading	4-channel Voltage output at same time and same value
Series loading	4-channel Voltage Series output of 4-in-1

Note: Each-channel Voltage Curve has some different according to the different switch-in impedance